


TYPICAL CONCRETE ANCHOR BLOCK FOR VERTICAL BEND

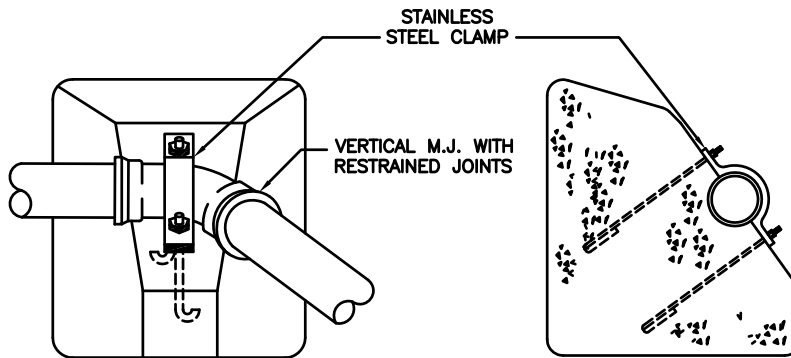

TYPICAL CONCRETE ANCHOR BLOCK FOR COMBINATION  
HORIZONTAL - VERTICAL BEND

NOTES: 1. CONCRETE ANCHOR BLOCKS SHALL BE INSTALLED BY THE CONTRACTOR TO WITHSTAND A THRUST PRODUCED BY THE TEST PRESSURE PLUS 50 P.S.I. MINIMUM DIMENSIONS FOR ANCHOR BOLTS AND CLAMPS ARE LISTED IN TABLE BELOW.

PIPE SIZE	ANCHOR BOLTS	STEEL CLAMPS
6"	5/8"	3" X 1/4"
8"	3/4"	3-1/4"X1/4"

PIPES 12" AND GREATER, SHALL BE DESIGNED USING RESTRAINED JOINTS.

## NAPA SANITATION DISTRICT



TITLE  
CONCRETE ANCHOR BLOCKS  
FOR VERTICAL BENDS

DATE: JAN 2016  
CHECKED BY: AD  
APPROVED BY: TH  
SCALE: NONE

DRAWING NO.

RW-1