

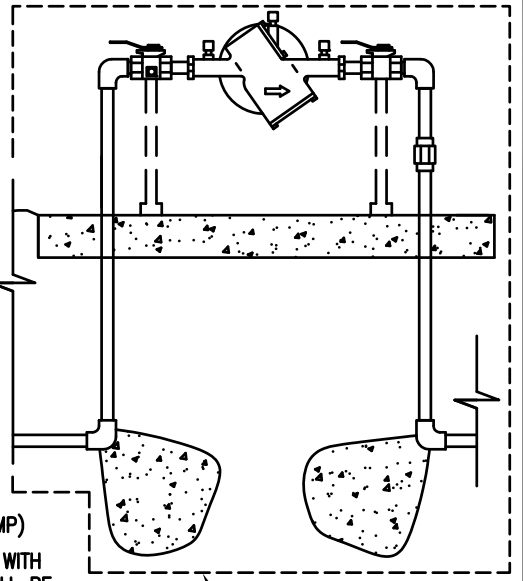


ALTERNATE MATERIALS MUST BE APPROVED BY THE DISTRICT PRIOR TO USE

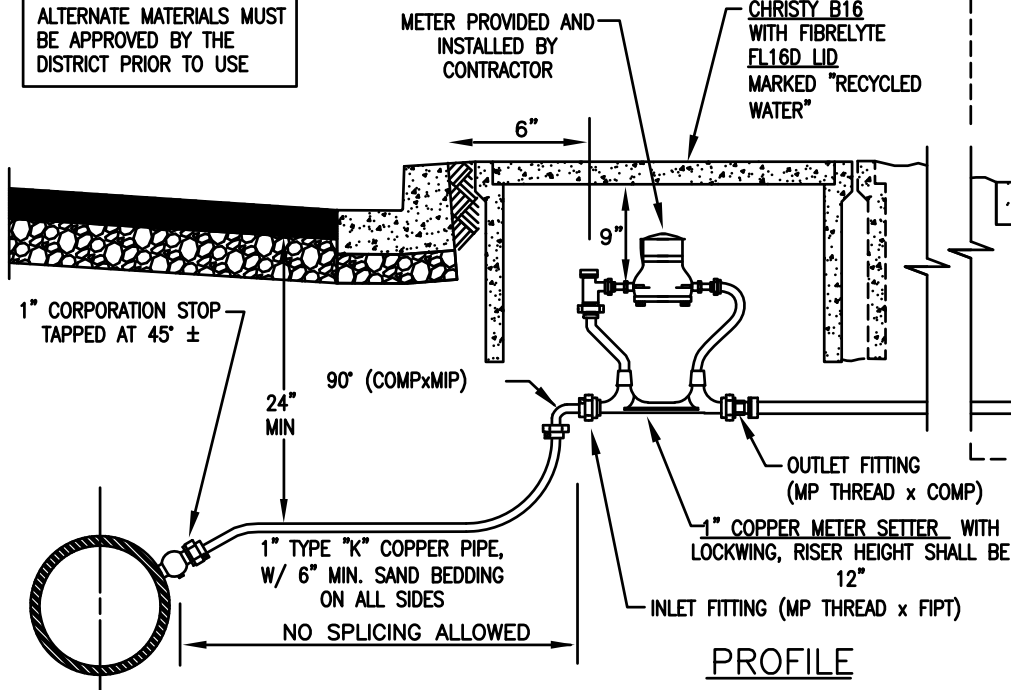

SEE RW-12 FOR BACKFLOW DEVICE INSTALLATION REQUIREMENTS

PROFILE

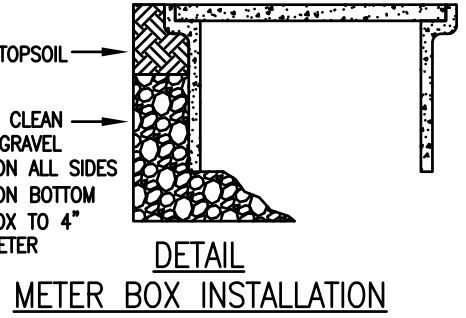

DETAIL METER BOX INSTALLATION

APPROVED FITTINGS

DESCRIPTION	MUELLER	FORD	JONES
METER YOKE	B-2404	VB74-12W-11-44	JO2C-CTS-UN-BV-MCX12"
INLET FITTING (MP THREAD x FIP)	H-14222	11-44	UN
OUTLET FITTING (MP THREAD x COMP)	H-14227	47-44Q	SG
CORP. STOP (CC x COMP)	B-25008	FB-1000-4-Q	J1937SG
90° BEND (COMP x MIP)	H-15531	L84-44-Q	J2619SG
90° BEND (COMP x COMP)	H-15526	L44-44-Q	J2611SG
SERVICE SADDLE	BR 2 S SERIES	202BS	J969

NOTES

1. CURB ADJACENT SIDEWALK: INSTALL METER AT CURB AS SHOWN. INSTALL BACKFLOW DEVICE BEHIND SIDEWALK.
2. APPROVED BACKFLOW PREVENTION DEVICES ARE REQUIRED ON ALL SERVICES.
3. METER BOX AND SERVICE LINE SHALL BE INSTALLED OUTSIDE OF DRIVEWAY, DRIVEWAY APPROACHES, AND OTHER VEHICULAR ACCESS WAYS.
4. SERVICE SHALL BE INSTALLED A MINIMUM OF 24" FROM ANY TAP, BELL, FITTING, OR OTHER SERVICE.
5. RECYCLED WATER METERS SHALL BE SET PRIOR TO ANY USE OF RECYCLED WATER SERVICE. USE OF JUMPERS, HOSE BIBS, OR OTHER DEVICES SHALL NOT BE PERMITTED.
6. METERS SHALL BE PLACED A MINIMUM OF 3' FROM ANY OBSTRUCTION (SIGN POST, MAIL BOX, FENCES, WALLS, ETC.). NO TREES SHALL BE PLANTED WITHIN 10' OR LARGE SHRUBS WITHIN 5' OF THE METER BOX. SEE STANDARDS FOR ADDITIONAL REQUIREMENTS.
7. WHEN TWO OR MORE NEW SERVICES ARE INSTALLED CLOSE TOGETHER, PERMANENT ADDRESS TAGS SHALL BE INSTALLED ON EACH METER SETTER SPECIFYING THE ADDRESS IT WILL BE SERVING. ADDRESS TAGS SHALL BE STAMPED METAL OR PLASTIC TAGS, AND SHALL BE INSTALLED PRIOR TO INSTALLATION OF RECYCLED WATER METERS.
8. SERVICES SHALL BE SIZED APPROPRIATELY FOR THE INTENDED USE OF THE SERVICE. DISTRICT MAY REQUEST AN ENGINEERED ANALYSIS OF THE SYSTEM (NEW OR EXISTING) TO EVALUATE THE APPROPRIATENESS OF THE RECYCLED WATER SERVICE SIZE. NO UNDERSIZED WATER SERVICES SHALL BE PERMITTED.

NAPA SANITATION DISTRICT



TITLE
3/4" & 1" RECYCLED
WATER SERVICE LATERAL
FOR 3/4" & 1" METERS

DATE: JUL 2012
CHECKED BY: MW
APPROVED BY: TH
SCALE: NONE

DRAWING NO.
RW-7