


NOTES:

1. CONTRACTOR SHALL POTHOLE AND VERIFY DEPTH AND LOCATION OF UTILITIES IF BORING AND JACKING METHOD OF INSTALLATION IS USED.
2. CONTRACTOR SHALL COMPLY WITH ALL PROVISIONS OR APPLICABLE ENCROACHMENT PERMITS AND TUNNELING REQUIREMENTS IF BORING AND JACKING INSTALLATION OR CASING USED.
3. CASING THICKNESS SHALL BE IN ACCORDANCE WITH CALTRANS REQUIREMENTS OR OTHER GOVERNING JURISDICTION, WHICHEVER IS GREATER.
4. SIZE CASING TO ACCOMMODATE CARRIER PIPE AND SKID INSULATOR.
5. PROVIDE ANTI-FLOATATION ON SKID INSULATOR AS NEEDED.
6. FOR VITRIFIED CLAY PIPE, REDWOOD SKIDS SHALL BE UTILIZED.
7. SKID CASING INSULATOR SHALL BE CALPICO (OR APPROVED EQUAL).



NAPA SANITATION DISTRICT

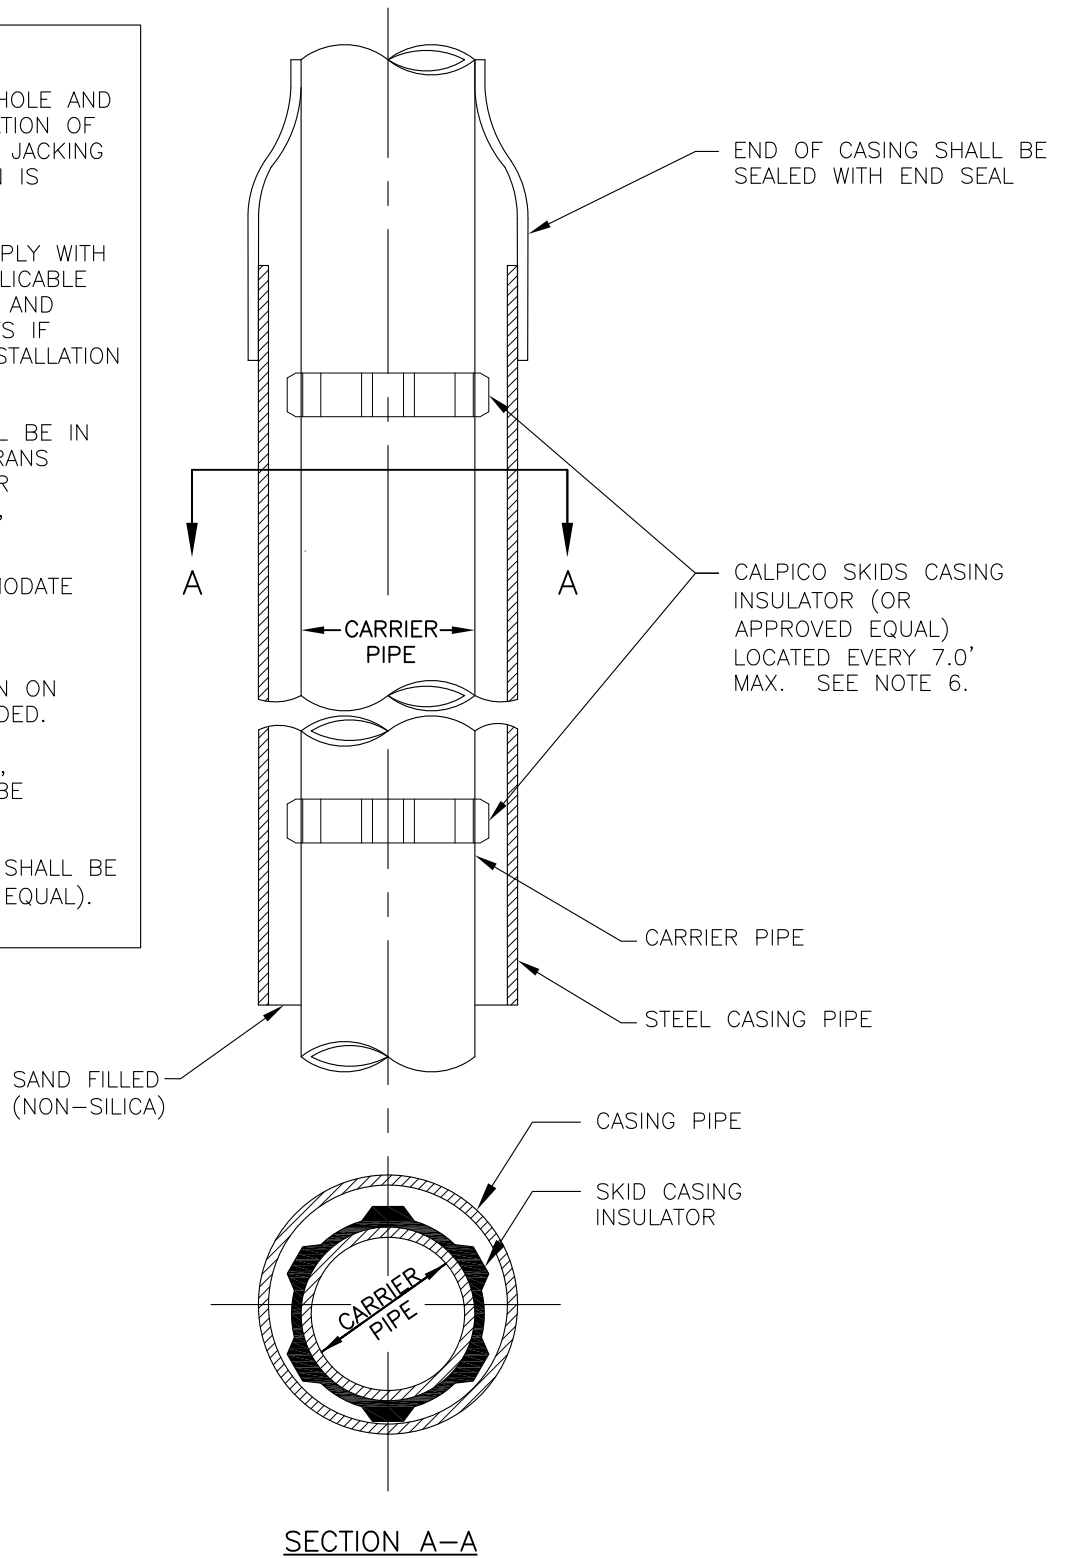

TITLE

**STANDARD
CASING
DETAIL**

DATE: **JAN 2016**

CHECKED BY: **AD**

APPROVED BY: **TH**

SCALE: **NONE**

DRAWING NO.

SS-18