


BREAK

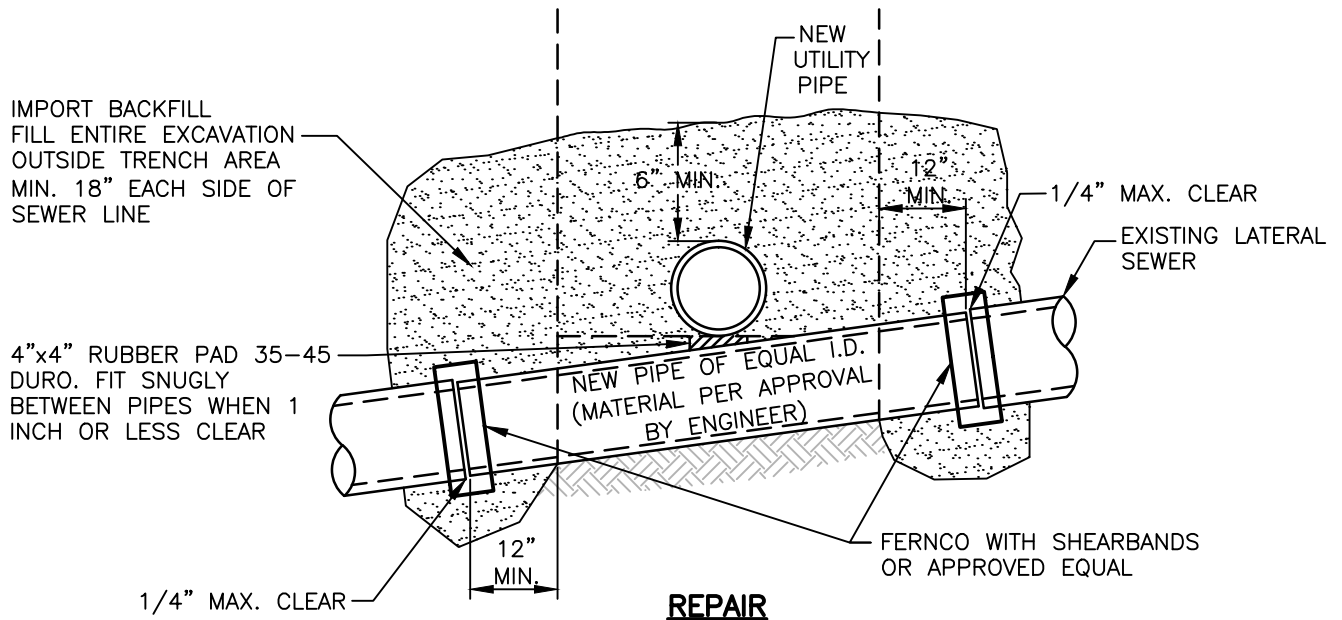

REPAIR

PROCEDURE:

REPAIR SHALL BE MADE AS SHOWN ABOVE AND AS DETAILED ON SHEET SS-3. WHEN CLEARANCE BETWEEN SEWER PIPE AND UTILITY PIPE IS 6 INCH OR MORE, REPAIR MAY BE MADE WITH THE SAME TYPE OF PIPE AS THE EXISTING SEWER. WHEN O.D. OF PIPES ARE WITHIN 1 INCH OF EACH OTHER, THERE SHALL BE A 4"x4" PAD OF 35-45 DUROMETER RUBBER PLACED SNUGLY BETWEEN THE PIPES.

NAPA SANITATION DISTRICT



TITLE

**SEWER LATERAL
CROSSING BELOW UTILITY
NO CONFLICT IN GRADE**

DATE:

MAY 2012

CHECKED BY:

MW

APPROVED BY:

TH

SCALE:

NONE

DRAWING NO.

SS-4