


12" DIAMETER PIPE AND LARGER

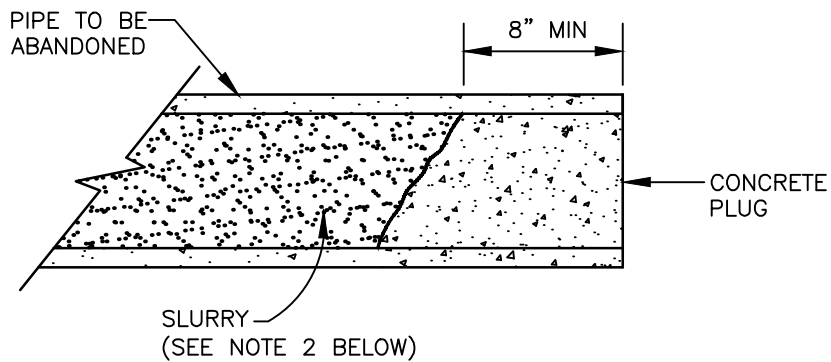

PIPES LESS THAN 12" DIAMETER

NOTES:

1. PIPE PLUGS SHALL BE INSTALLED TO THE SATISFACTION OF THE DISTRICT ENGINEER.
2. ABANDONED MAINS SHALL BE FILLED COMPLETELY WITH SLURRY.

NAPA SANITATION DISTRICT



TITLE

**ABANDONED
PIPE PLUG**

DATE: MAY 2012

DRAWING NO.

CHECKED BY: MW

APPROVED BY: TH

SCALE: NONE

SS-26