


**12" DIAMETER PIPE AND LARGER**

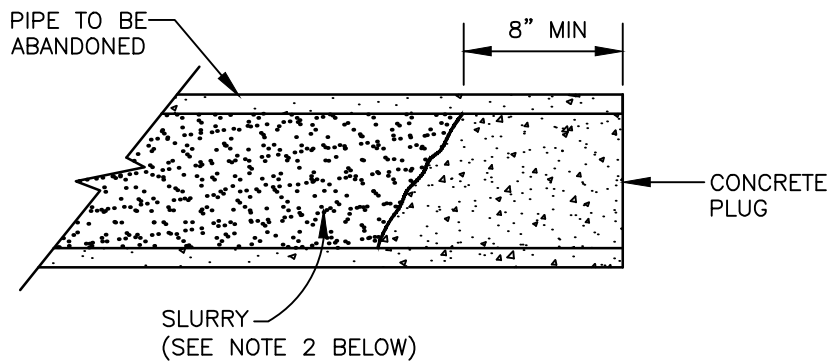

**PIPES LESS THAN 12" DIAMETER**

NOTES:

1. PIPE PLUGS SHALL BE INSTALLED TO THE SATISFACTION OF THE DISTRICT ENGINEER.
2. ABANDONED MAINS SHALL BE FILLED COMPLETELY WITH SLURRY.

**NAPA SANITATION DISTRICT**



TITLE

**ABANDONED  
PIPE PLUG**

DATE: MAY 2012

CHECKED BY: MW

APPROVED BY: TH

SCALE: NONE

DRAWING NO.

**SS-26**